

CHATHAM COUNTY PURCHASING & CONTRACTING DEPARTMENT

ADDENDUM NO. 2 TO 20-0027-5

FOR: COOLING TOWERS REPLACEMENT AT CHATHAM COUNTY DETENTION CENTER

PLEASE SEE THE FOLLOWING FOR ADDITIONS, CLARIFICATIONS AND/OR CHANGES:

SEE ATTACHED SHEET (1 page) FOR RESPONSES TO QUESTIONS RECEIVED

SEE ATTACHED LAYOUT OF COOLING TOWERS (1 page)

NOTE: A PDF of the Plan Sheets is now available for download on the Purchasing website.

BID OPENING REMAINS: 2:00 PM, THURSDAY, JULY 30, 2020

THE PROPOSER IS RESPONSIBLE FOR MAKING THE NECESSARY CHANGES AND MUST ACKNOWLEDGE RECEIPT OF ADDENDUM.

7/22/20
DATE



ROBERT E. MARSHALL
SENIOR PROCUREMENT SPECIALIST
CHATHAM COUNTY

QUESTION RECEIVED:

1. Q) Will there be any consideration for alternate cooling tower manufacturers? If so, will there be an allowance to exceptions to the specifications?

A) There will be no alternates considered regarding the cooling towers.


2. Q) It was noted at the Pre-Bid that conditioning of the facility is required to be maintained while the cooling towers are being replaced. Please provide the capacity needed to maintain cooling conditions of the facility.

A) Requires 1 of the 386 ton units to remain on.

3.Q) Does one of the existing chiller/cooling tower arrangements has sufficient capacity for conditioning the facility, if so, define which one and can it be used for conditioning during the cooling tower replacement, or will a temporary chiller be required.

A) Attached to this addendum is a layout showing the cooling towers and chillers again 1 of the 386t must remain active. As you can see by the drawing chiller 3 can stay active while the twin cooling tower and the small cooling tower is removed.

Cooling Towers

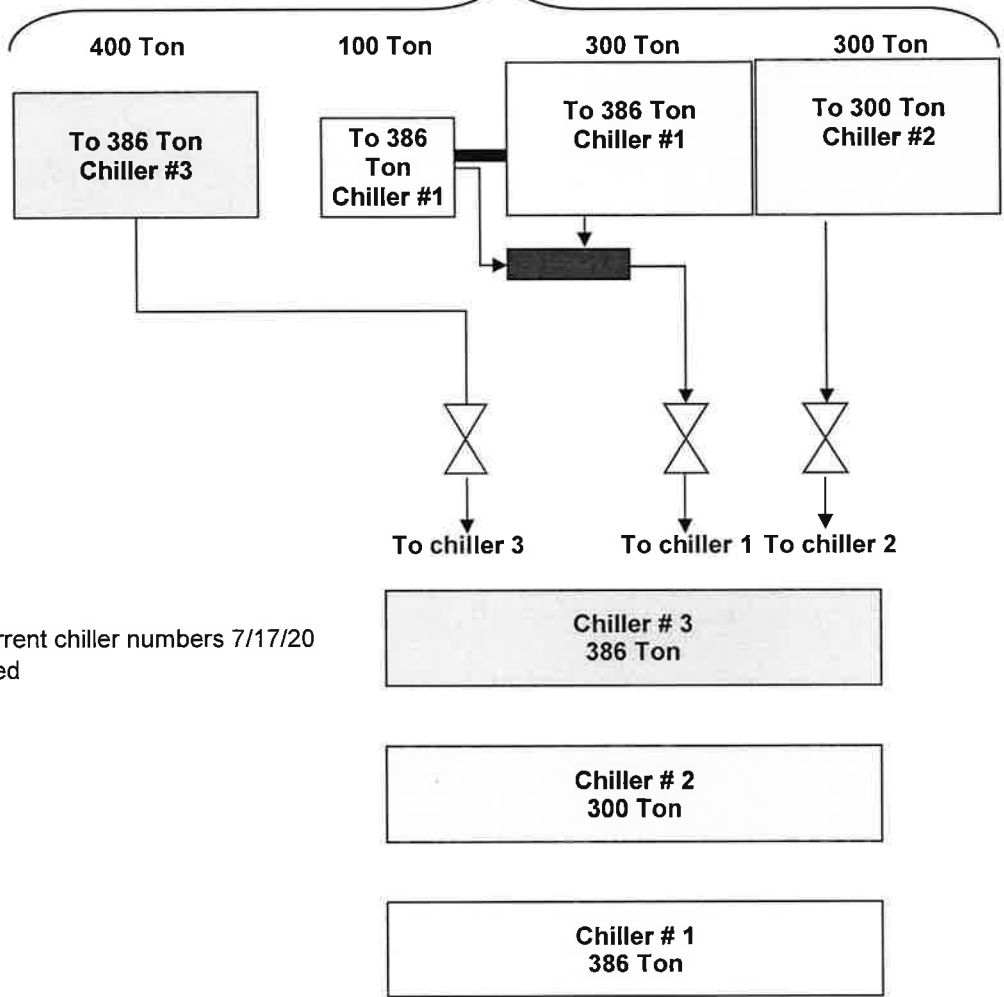

Updated to show current chiller numbers 7/17/20
One and two switched